


ARRAY DETAILS:		
MOUNTING PLANE:	AZIMUTH:	TILT:
MP1	123°	8°
MP2	303°	8°

UTILITY NOTES:

- UTILITY SHALL HAVE 24-HOUR UNRESTRICTED AND UNOBSTRUCTED ACCESS TO THE UTILITY DISCONNECT SWITCH.
- UTILITY SHALL HAVE 24-HOUR UNRESTRICTED ACCESS TO THE DEDICATED PHOTOVOLTAIC SYSTEM kWh METER AND ALL PV SYSTEM COMPONENTS LOCATED A SERVICE ENTRANCE.
- WORKSPACE IN FRONT OF THE AC ELECTRICAL SYSTEM COMPONENTS SHALL BE IN ACCORDANCE WITH UTILITY AND NEC REQUIREMENTS (SECTION 300 OF THE APS ESRM; SECTION 8.2 OF THE APS INTERCONNECTION REQUIREMENTS; CURRENT SRP ELECTRICAL SERVICE SPECIFICATIONS).
- ELECTRIC METER SEPARATION BETWEEN GAS AND WATER SHALL BE VERIFIED. (SECTION 301.15 OF THE APS ESRM; CURRENT SRP ELECTRICAL SERVICE SPECIFICATIONS).
- NO GAS LINE.

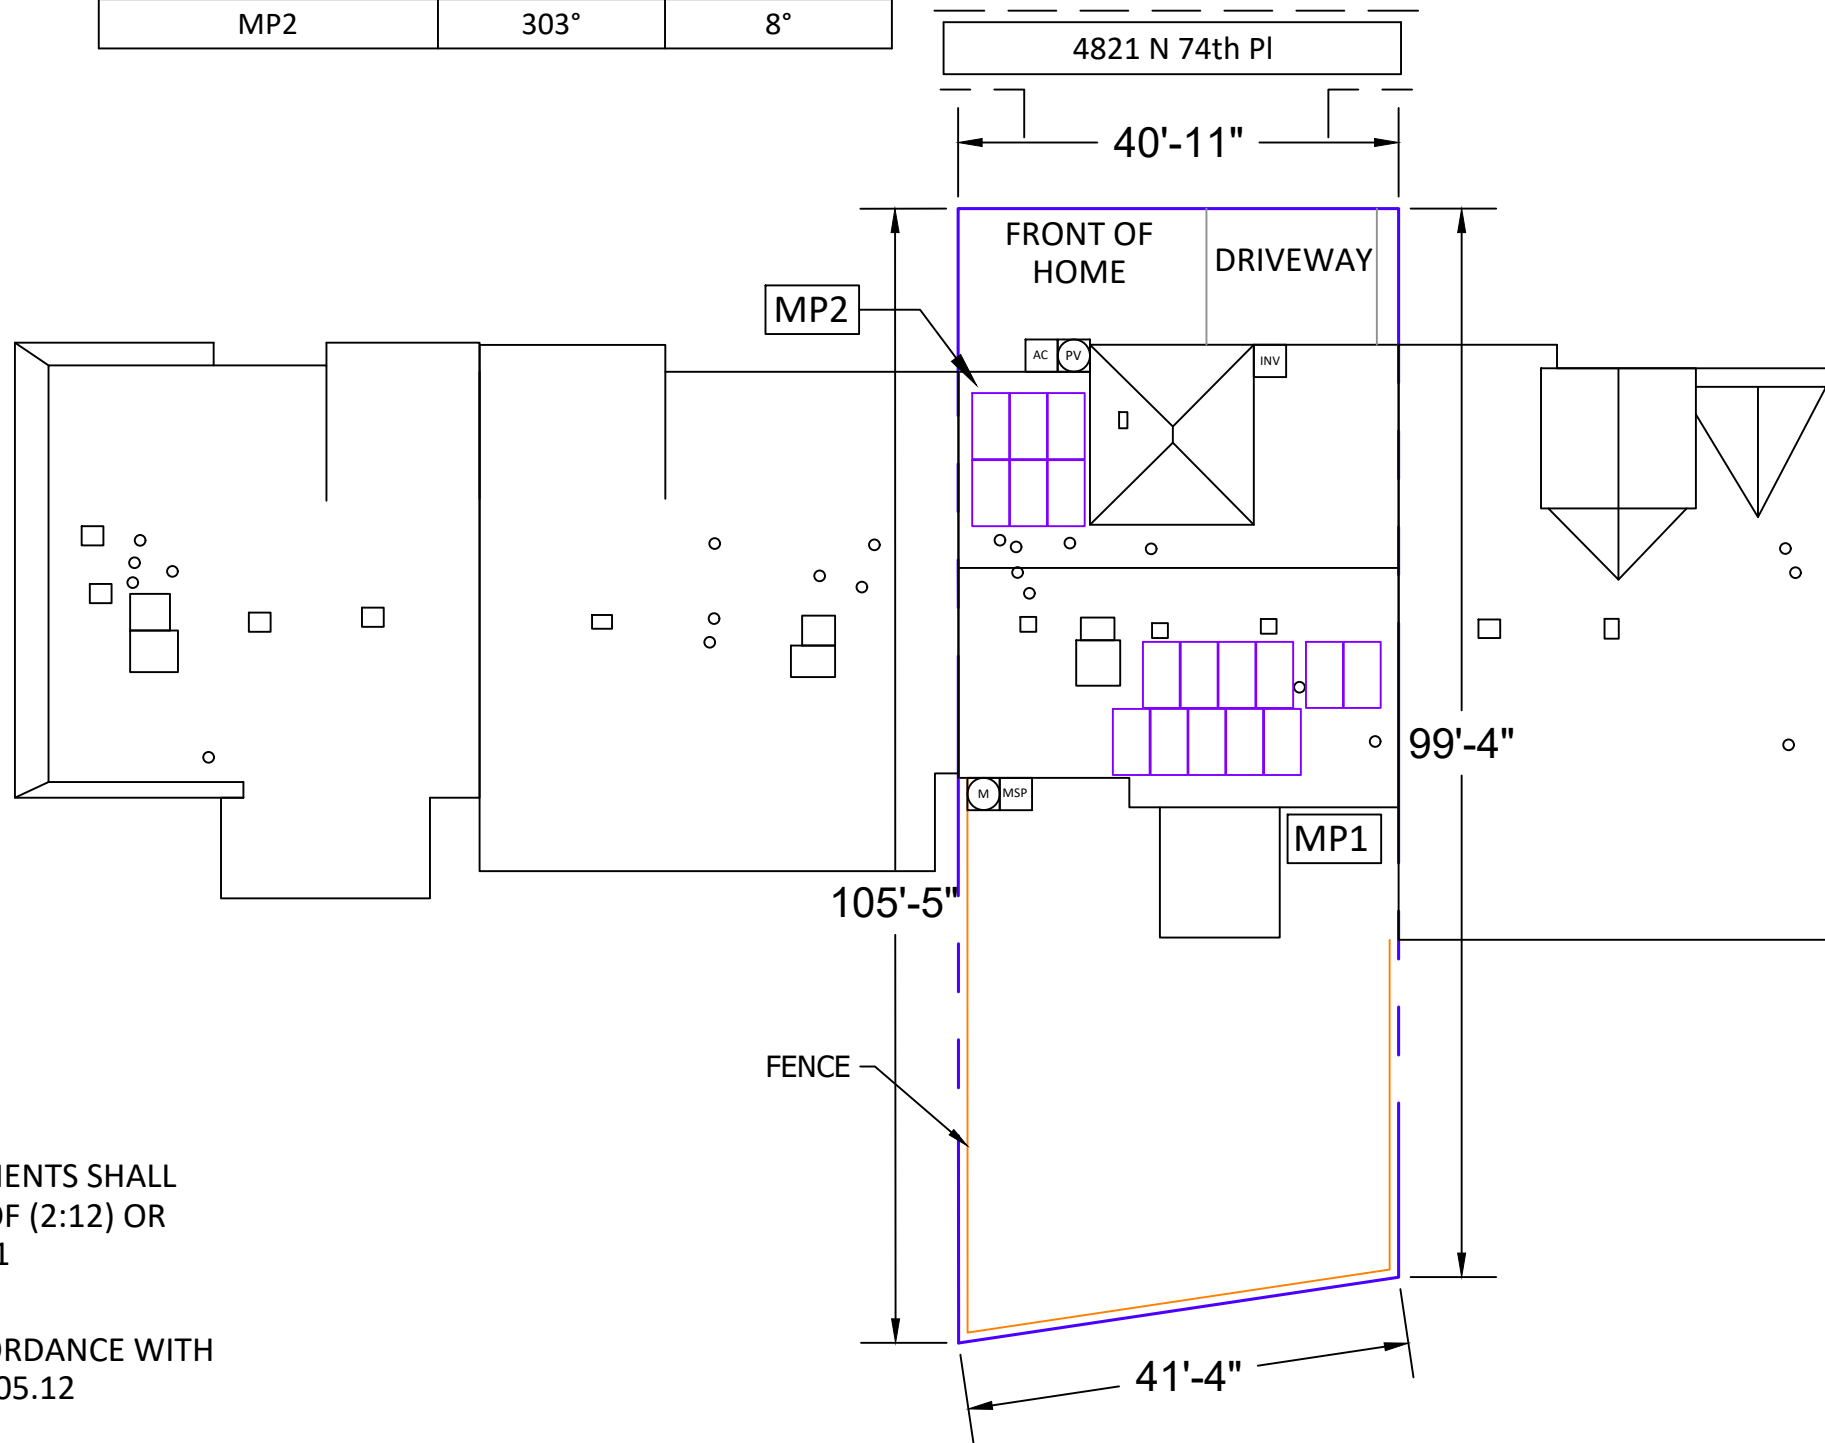

3FT FIRE ACCESS PATHWAY REQUIREMENTS SHALL NOT APPLY TO ROOFS WITH SLOPES OF (2:12) OR LESS PER FFPC 11.12.2.2.1

PV SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH NEC SECTION 690.17, 705.10, 705.12



BRIGHT HOME ENERGY

CONTRACTOR INFORMATION:
 BRIGHT HOME ENERGY
 4675 E COTTON CENTER BLVD
 STE 173
 PHOENIX, AZ 85040
 License #ROC324636

SITE INFORMATION

JIM LENZO
 4821 N 74TH PL
 SCOTTSDALE, AZ 85251
 AC SYSTEM SIZE: 6 KW AC
 DC SYSTEM SIZE: 6.885 KW DC
 LAT, 33.5069877 LONG, -111.9196601
 (17) HANWHA Q.PEAK DUO BLK ML-G10+ 405
 (1) SOLAREEDGE SE6000H-US (240V)
 (17) SOLAREEDGE S440

ARIZONA PUBLIC SERVICE

DRAWN BY: SoloCAD

3/15/2024

SITE PLAN - PV02

EQUIPMENT LEGEND:

- | | | | | | | |
|--------------------|---|--------------|-------------|--------------------|--------------|------------------------------|
| UTILITY METER | VISIBLE, LOCKABLE, LABELED UTILITY DISCONNECT | INVERTER | SUB PANEL | SERVICE DISCONNECT | PV MODULES | FIRE ACCESS PATHWAY (3' TYP) |
| MAIN SERVICE PANEL | UNI-DIRECTIONAL METER | COMBINER BOX | LOAD CENTER | BATTERY(IES) | JUNCTION BOX | PROPERTY LINE |